


FIRE DEPARTMENT CONNECTION (FDC) MARKING STANDARDS

- All FDC signs shall be visible from the street for approaching fire apparatus.
- Signs shall be a reflective red background with reflective white lettering and address numbering.
- An approved Fire Department sign shall be made of 0.040 - 0.080 aluminum material.
- For wall mounted FDCs: the sign will measure 12 inches high and 18 inches wide with the letters “**FDC**” 6 inches high (minimum). The sign shall be mounted on the wall above the FDC a minimum of 6 - 8 feet above grade.
DO NOT PAINT the hose connection.
- For free standing FDCs: the sign will measure either 12 inches high and 12 inches wide or 10 inches high and 7 inches wide with the letters “**FDC**” measuring 4 inches high, the building address with any other building identification (building number or letter) below measuring 1-2 inches high, the sign mounted to the pipe, and the FDC pipe painted red.
DO NOT PAINT the hose connection.

Examples:

Wall Mounted FDC sign

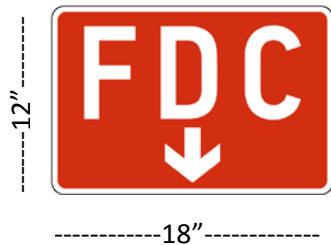

Free Standing FDC signs



FIRE CONTROL ROOM MARKING STANDARDS

- Fire alarm, fire sprinkler, and fire command rooms shall be identified on exterior and interior doors if applicable. Signs shall have reflective red background with reflective white lettering. The lettering shall be a minimum of 4 inches high for exterior signs, a minimum of 2 inches high for interior signs, and shall be identified as: “**FIRE CONTROL ROOM**”.